



June 27, 2018

Tyler Elliott
Sure Board
2045 Placentia Avenue
Costa Mesa, CA 92627

Re: HD #14 / OlyBond Pull Test - 4' x 8' Fiber Cement Board

Dear Tyler,

I have enclosed the Job Report Number PT-00871 from the job referenced above. The report was recorded by Alexander Paxton, OMG Territory Manager.

OMG is interested in your feedback on our services. Please visit www.omglistens.com to take a brief, 2-3 minute survey to help us understand how we did on this project, and more importantly, anything we can do better next time. We value your time and input, and thank you in advance for your participation.

If you have any further questions, please feel free to call.

Sincerely,

A handwritten signature in black ink, appearing to read "Alexander Paxton", is written in a cursive style.

To: support@sureboard.com; apaxton@olyfast.com

PULL TEST REPORT



JOB NAME	HD #14 / OlyBond Pull Test - 4' x 8' Fiber Cement Board
JOB LOCATION	Costa Mesa, CA
ROOF AREA (SQFT)	
BUILDING HEIGHT (FT)	NA
PROJECT TYPE	New Construction
THICKNESS OF EXISTING ROOF ASSEMBLY	3/4"
ROOF COVER TYPE	Unknown
NEW SYSTEM MANUFACTURER	Unknown
FASTENER(S) TESTED	Heavy Duty #14

REPORT NUMBER	PT-00871
TEST DATE / TIME	6/26/2018 2:30:00 PM
AMBIENT TEMPERATURE	84°F
GROUND ROUGHNESS	
TESTER MANUFACTURER	DMD Force-2000
MAX CAP OF TESTER (LBS)	2,000
TEST PERFORMED BY	Alexander Paxton
TEST CUT AREA REPAIRED BY	Tyler Elliott
TEST WITNESSED BY	Tyler Elliott

INSULATION MANUFACTURER	INSULATION TYPE	THICKNESS
Unknown	Unknown	NA

DECK TYPE	THICKNESS
Other - See Comments	3/4"

Disclaimer: Manufacturer's installation requirements shall be followed when using any of the tested fasteners or adhesives. Neither the technician performing the pullout tests, nor his/her company is responsible for the waterproofing integrity of the repairs. This test report does not certify the structural integrity of the roof deck.

TEST RESULTS




TEST LOCATION NUMBER	PULL VALUE (LBF)	FASTENER TESTED	PENETRATION (IN)	BIT DIAMETER (IN)	COMMENTS
1	701	OMG Heavy Duty #14	3/4"		
2	727	OMG Heavy Duty #14	3/4"		
3	674	OMG Heavy Duty #14	3/4"		
4	700	OMG Heavy Duty #14	3/4"		
5	677	OMG Heavy Duty #14	3/4"		
6	726	OMG Heavy Duty #14	3/4"		
7	665	OMG Heavy Duty #14	3/4"		
8	672	OMG Heavy Duty #14	3/4"		
9	638	OMG Heavy Duty #14	3/4"		
10	679	OMG Heavy Duty #14	3/4"		

PULL TEST COMMENTS

Fasteners were tested in Sure Board Fiber Cement board with 20 gauge galvanized steel sheathing. This board was tested as the deck of the test with steel sheathing on underside.

HD #14 / OLYBOND PULL TEST - 4' X 8' FIBER CEMENT BOARD

Fastener Tests shown as 1-10
Adhesive Tests shown as A-D

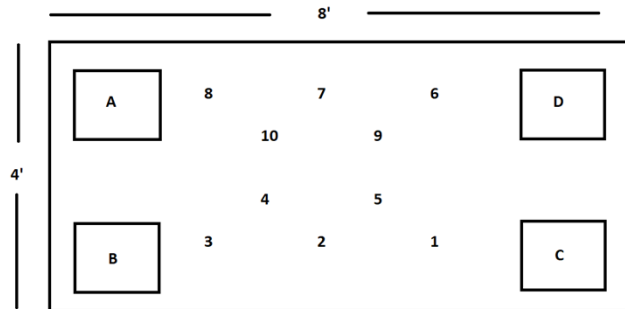

END OF REPORT